



Government of West Bengal
Public Health Engineering Directorate
Nadia Divisional Laboratory, S.T.P. Kalyani, Nadia.

Water Quality test Report


TECHNO INDIA GROUP PUBLIC SCHOOL
Mainpur Ghat Road, Nabadwip, PIN-741302

Sample collected & sent by the agency

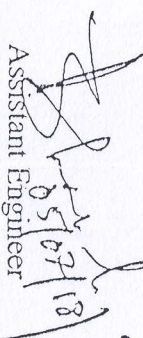
Sl	Name of Location	pH	Total Hardness (mg/l)	Turbidity (NTU)	TDS (mg/l)	[As] (mg/l)	[Mn] (mg/l)	[Fe] (mg/l)	TC	FC
	Techno India Group Public School, Nabadwip	7.33	455	0.80	622	<0.01	0.08	0.11	5	3
IS:10 revisio	Requirement acceptable limits	6.5-8.5	200	1	500	0.01	0.1	0.3	<2 per 100ml	Nil
	In absence of alternative source Permissible limits	6.5-8.5	600	5	2000	0.01	0.3	0.3	<2 per 100ml	Nil


Chemist 05-07-18

Nadia Divisional Lab.
P.H.Engineering Dte.


Microbiologist

Nadia Divisional Lab.
P.H.Engineering Dte.


Assistant Engineer

Kalyani Sub-Division -I
P.H.Engineering Dte.


Vice Principal
TIGPS
Nabadwip-741302


Manager
TIGPS
Nabadwip-741302